


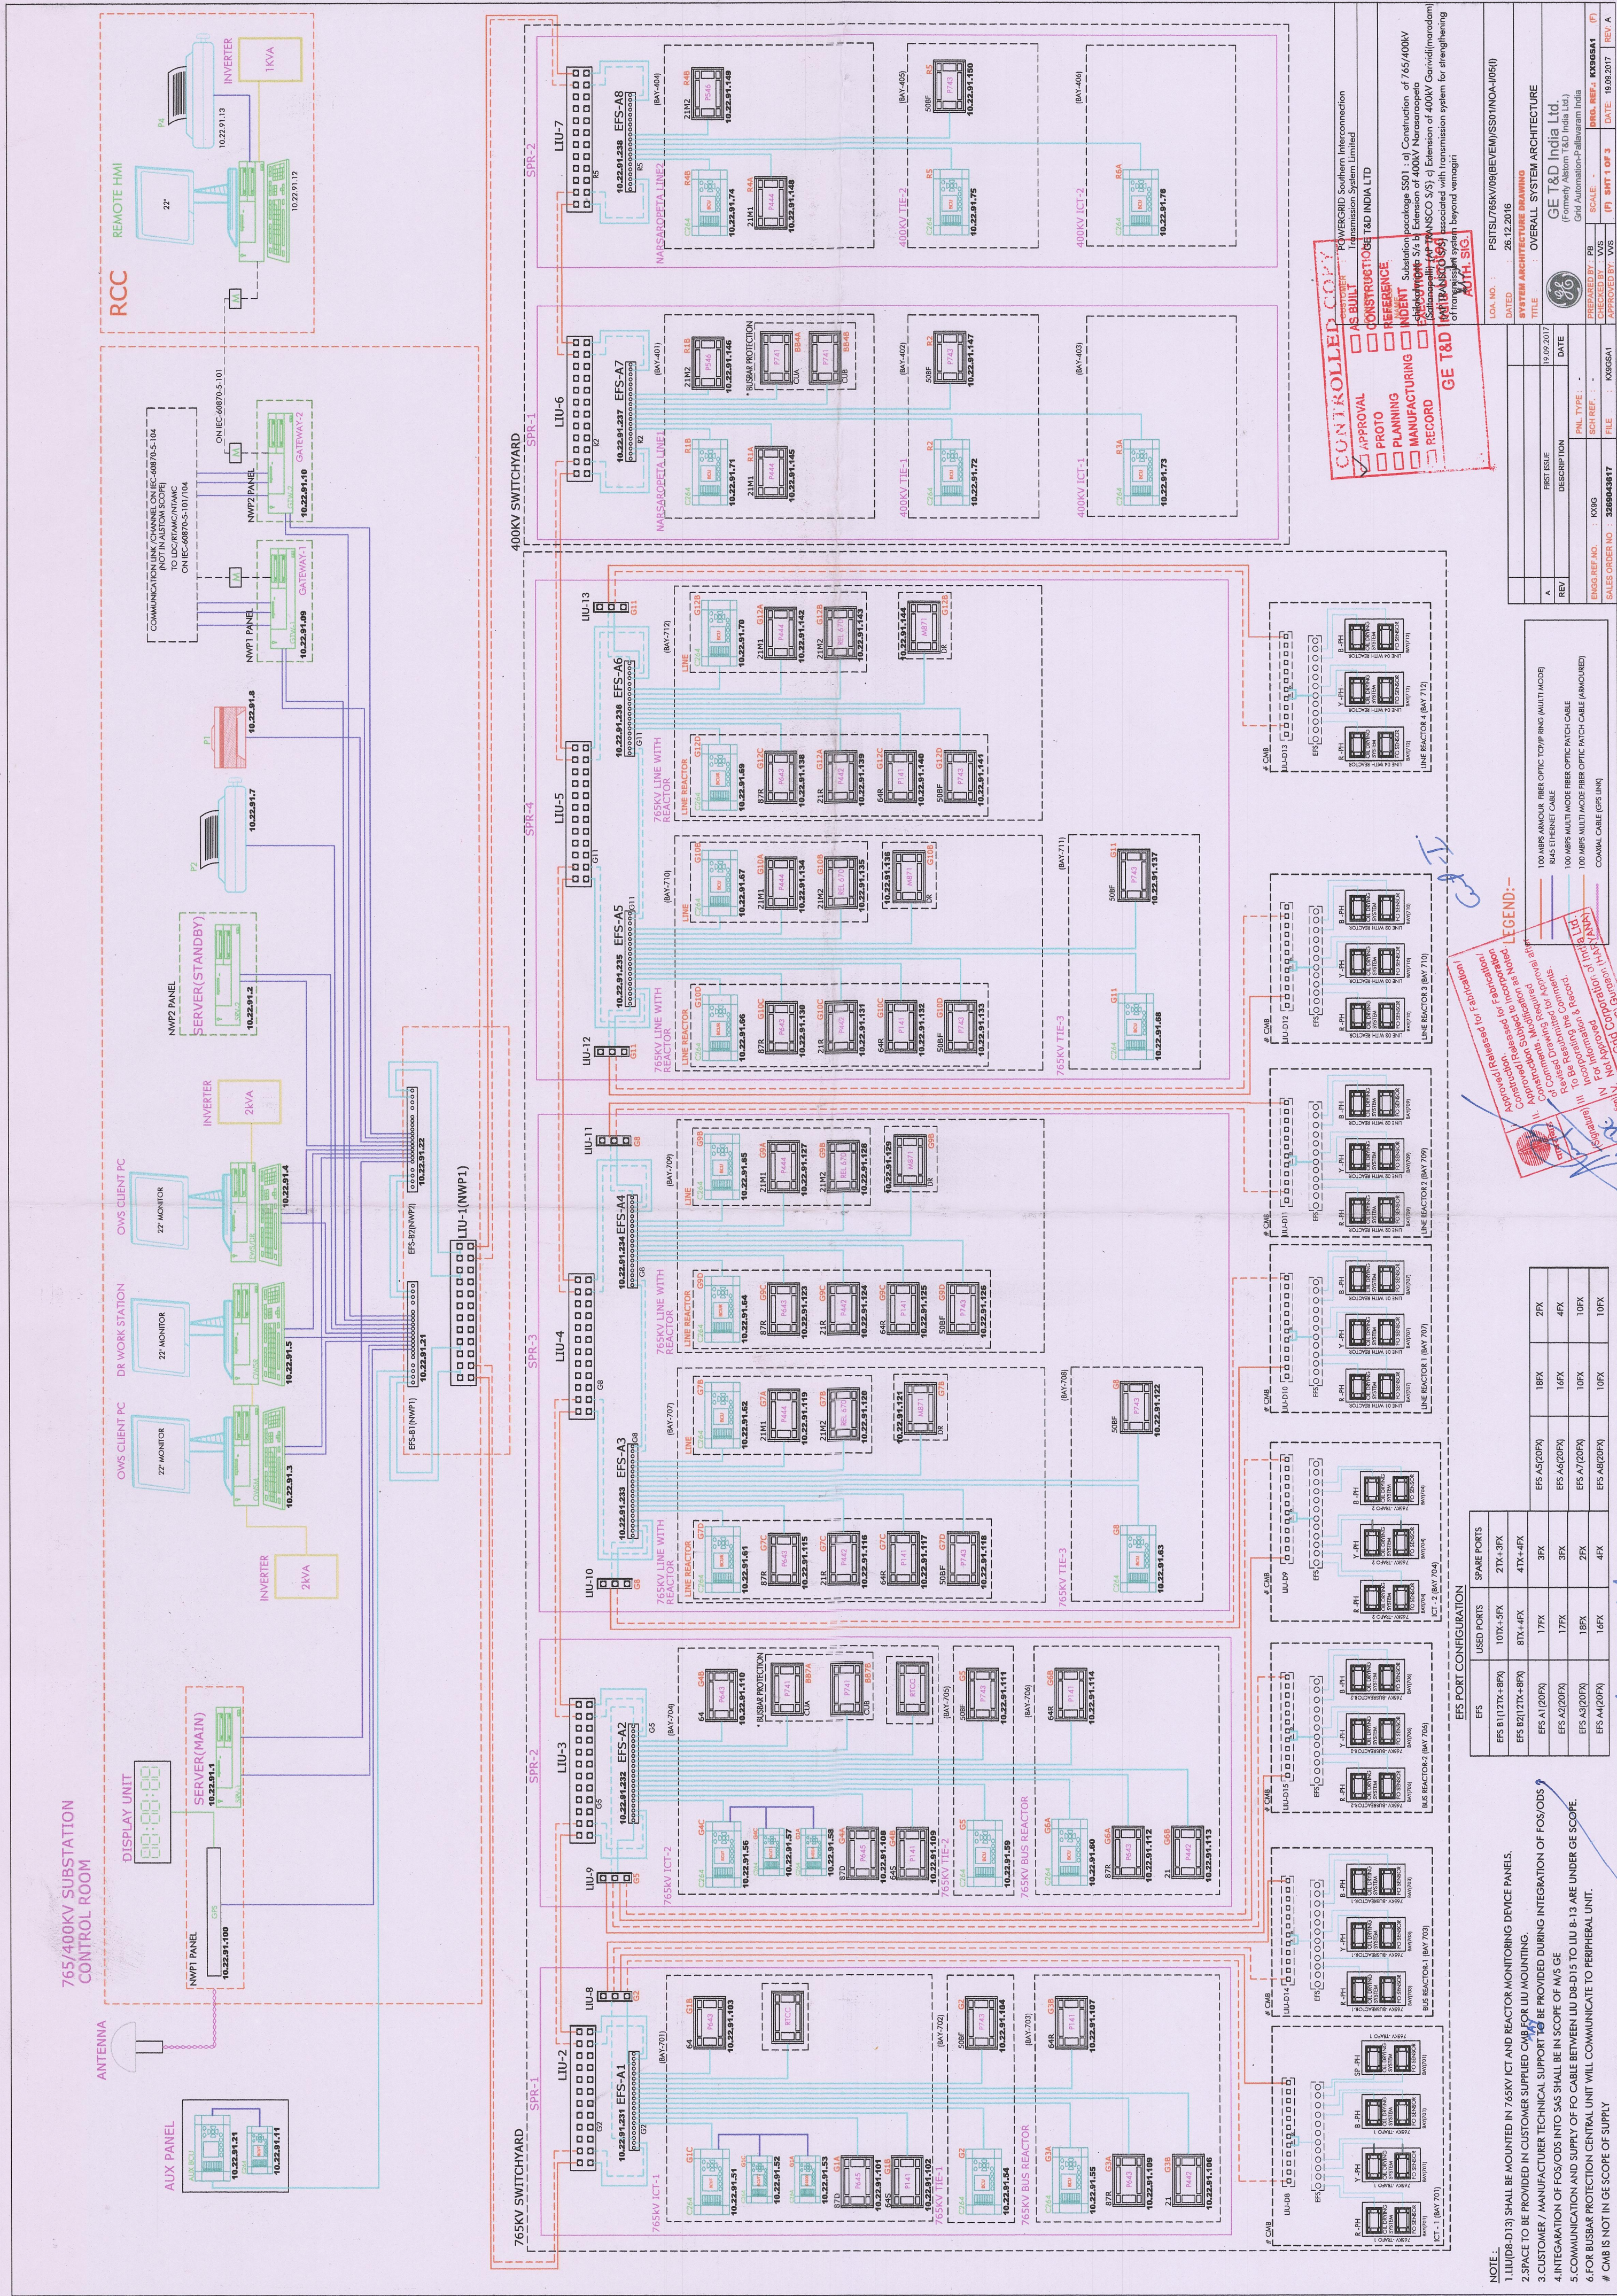

NOTE :

1. LIU1(D8-D13) SHALL BE MOUNTED IN 765KV ICT AND REACTOR MONITORING DEVICE PANELS.
2. SPACE TO BE PROVIDED IN CUSTOMER SUPPLIED CAB FOR LIU MOUNTING.
3. CUSTOMER / MANUFACTURER TECHNICAL SUPPORT TO BE PROVIDED DURING INTEGRATION OF FOS/ODS.
4. INTEGRATION OF FOS/ODS INTO SAS SHALL BE IN SCOPE OF M/S GE
5. COMMUNICATION AND SUPPLY OF FO CABLE BETWEEN LIU D8-D13 TO LIU 8-13 ARE UNDER GE SCOPE.
6. FOR BUSBAR PROTECTION CENTRAL UNIT WILL COMMUNICATE TO PERIPHERAL UNIT.

IS NOT IN GE SCOPE OF SUPPLY

Nevertheless it is not bounding on $\text{order} / \text{manufacture}$.